

Research Article

Auxiliary kWh Efficiency of Substations Using Renewable Energy Potency in East Kalimantan Province

Chandra Lima Silalahi^{1*}; Ananda Priatama¹; Saut Parsaoran S¹; Setyaningsih Nugrohowidi¹; Bambang Priyono¹

¹ Universitas Indonesia

* Corresponding author: Chandra Lima Silalahi, feliciasilalahi3110@gmail.com

CITATION

Author Name. (2024). Article title.
Journal of Technology and Policy in Energy and Electric Power. (1): 1.
<https://doi.org/10.33322/t0s6tr04>

ARTICLE INFO

Received: 10 December 2024

Accepted: 22 December 2024

Available online: 30 December 2024

COPYRIGHT



Copyright © 2024 by author(s).

Journal of Technology and Policy in Energy and Electric Power is published by PLN PUSLITBANG Publisher, LLC. This work is licensed under the Creative Commons Attribution (CC BY) license.
<https://creativecommons.org/licenses/by/4.0/>

Abstract: PT PLN (Persero) as the Indonesian state electricity supply company must carry out an energy transition in terms of generation, transmission and distribution. Substations in Indonesia's electric power transmission sector have not yet incorporated the idea of green energy into their operations, despite the fact that there is a great deal of potential for green energy in substations, such as the usage of solar and wind energy. The primary power source for the auxiliary substation is energy from the grid, with diesel power serving as a backup. However, the energy mix in the Kalimantan grid is still dominated by energy from coal (based on the Laporan Evaluasi Operasi Tahunan PLN UIP3B 2023). This research investigates the technical and economic viability of utilizing renewable energy in auxiliary substations to mitigate the company's escalating financial burden. Technically, the study aims to determine the optimal PV panel capacity required for auxiliary power needs. Economically, it evaluates the total investment and operational costs, Internal Rate of Return (IRR), Return on Investment (ROI), payback periods, and Levelized Cost of Energy (LCOE). Unique to this study is the direct measurement of kWh consumption data from 23 substations in East and North Kalimantan, a method not previously employed. The findings provide recommendations on the appropriate PV capacity for installation in substations and present economic analysis.

Keywords: substation, energy transition, techno-economy analysis

1. Introduction

Paris Agreement plays a crucial role in addressing the impacts of climate change by limiting the temperature increase to 1.5°C by 2060. As a country that has ratified the Paris Agreement, Indonesia is committed to reducing greenhouse gas emissions by 29% through domestic efforts and up to 41% with international support by 2030. In 2025 and 2028, the electricity sector is targeted to have an EBT mix of 23% and 28%, respectively, which will then become a reference for the Electricity Supply Business Plan (ESBP) [1].

As of August 2020, Indonesia's renewable energy potential was 417.8 GW, six times higher than its current power generation capacity of 69.6 GW [2]. According to Presidential Regulation No. 22/2017 on the National Energy Plan, the potential capacity of solar power plants in Indonesia is 207,898 MW (megawatts). In Indonesia, the average solar energy received on horizontal

surfaces ranges from 4.73 to 5.77 kWh per square meter per day, with an average of 11.8 to 12.4 hours of daylight per day. However, the share of solar capacity in Indonesia's energy production is still very low, at only 3 MW in 2002, 90 MW in 2018, and a further 152 MW in 2019 [3]. This highlights the need to accelerate the adoption of renewable energy technologies such as solar photovoltaic (PV) to reduce dependence on conventional energy sources that contribute to carbon emissions.

The role of Perusahaan Listrik Negara (PLN), as the largest electricity provider in Indonesia, is key to accelerating the energy transition towards net zero emissions. To address the slow expansion of solar energy in the residential, commercial, and industrial sectors, the Indonesian government, under the Ministry of Energy and Mineral Resources (MEMR), has implemented several regulations that provide a legal structure and metering agreements for PV system users in the country. In 2013, PLN implemented a regulation known as PLN Regulation 0733.K/DIR/2013, which allows the installation and operation of photovoltaic (PV) systems alongside the national grid. However, within the electricity transmission system, substations have yet to incorporate the concept of 'green' into their operations. Although there is significant potential in substations, such as the use of rooftop solar PV.

Substations require low-voltage power for their auxiliary loads, which include lighting, HVAC, transformer cooling fans, and battery charging. Most of these require a guaranteed, uninterrupted supply [4]. Self-discharging transformers, or substation auxiliaries, typically draw power from the grid to supply additional loads at substations. Based on the Annual Operation Evaluation (AOE) of the Electric Power System at PT PLN (Persero) Unit Induk P3B Kalimantan, it is reported that the energy mix in the Kalimantan grid is still dominated by coal at 70–80%. The total energy consumption of self-consumption transformers at substations is constantly increasing, from 3,092,350 kWh in 2021 to 3,285,410 kWh in 2023. This data shows that the use of power transformers as the main source to meet additional loads at the substation will incur relatively high costs, which will ultimately become a burden on the company.

The purpose of this study is to provide a technical and economic analysis of the potential use of renewable energy in substations to supply additional loads through PS transformers or substation auxiliaries, so that it is cost-effective and can reduce the burden on the company in the future. The levelized cost of electricity from solar PV technology on the grid is lower than that of coal technology [5]. This study focuses exclusively on a hybrid system consisting of solar panels (PV), an inverter, and a grid. From an economic point of view, kWh consumption data will be used, which will be multiplied by the cost of production (COP) to obtain the company's expenditure.

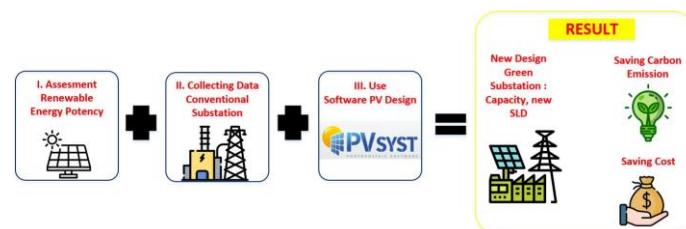


Figure 1. Research Method

Per year for the auxiliary substation, so that data in the form of IRR, ROI payback periods, and LCOE will be obtained from the simulation results.

2. Materials and methods

This research will discuss how to present the existing green energy sources in 23 substations spread over the provinces of East Kalimantan and North Kalimantan (Fig. 2). The study will focus on two aspects: technical and economic. Based on (Fig. 1) the author applies several steps to the research stages as follows:

A. Assessment of Renewable Energy Potential

In this stage, an assessment of renewable energy potential in the East Kalimantan and North Kalimantan regions is carried out. The renewable energy potential in the substation is solar energy and wind energy. The solar energy potential based on ESMAP (Energy Sector Management Assistance Program) has an average global horizontal irradiation (GHI) of 4.4 kWh/m² in this region [6]. For wind energy, however, the potential in East Kalimantan and North Kali-Ex is relatively small, with an average wind speed of 2.01 m/s at a height of 10 meters [7]. Based on this, the renewable energy used in this study is solar energy by utilizing the substation roof.

B. Collecting Data From Conventional Substation

At this stage of the research, the authors collected primary data on the energy consumption of auxiliary substations per half hour in 23 substations in East and North Kalimantan. The list of substations and coordinate points in this study is shown in Table I. These electrical energy consumption data are multiplied by the average production cost price to obtain the amount of cost incurred by the company for kWh of auxiliary substation. In addition, the coordinate data of the substation is used to see the potential of solar energy at each point. Therefore, one of the advantages of this research is that it examines technical and economic studies with primary data measurements from real auxiliary substation loads.

Several studies have carried out similar research in this area. According to Mohamed Dib et al., the combination of PV systems with existing systems in transmission substations can improve the quality of the energy supplied and reduce losses, but they have not provided further technical-economic studies before generalizing this solution [8].

As stated by Washington de Araujo Silva Junior et al., auxiliary systems (SAux) in transmission substations require a continuous power supply. In the event of an external power supply becoming unavailable, the system is reliant on diesel emergency generators (DEG), which have slow response times and are susceptible to failure. The experimental results demonstrate that the battery energy storage system in a photovoltaic configuration is capable of operating autonomously and maintaining a stable voltage and frequency without experiencing outages. The system is capable of withstanding sudden changes in active power and recharging the BESS with excess energy from the PV system. This solution ensures a reliable and continuous energy supply for auxiliary systems in the substation. Nevertheless, further studies are necessary to determine the optimal size and technical and economic viability of this solution [9].

Al Ashwal suggests that additional research is necessary to enhance the design of photovoltaic (PV) systems and assess their effectiveness in various operational scenarios. Future research should prioritize conducting a thorough technical-economic study and developing techniques for effectively integrating photovoltaic (PV) plants into a broader power grid. [10].

As proposed by Bogdan Filip and Marian Dragomir, this study recommends further investigation to assess the efficacy of solar plants in diverse operational and geographical contexts [11].

As posited by Mpai Letebele and John Van Coller, future studies ought to prioritize a more comprehensive technical and economic analysis alongside the development of more efficacious energy management strategies. This will enhance the reliability and efficiency of auxiliary systems in transmission substations [4].

Consequently, the research will investigate the techno-economic analysis of photovoltaic use in 23 East Kalimantan substations, utilizing geographic data and varying load data for each substation.

C. Use of PV Syst Software for Design PV System

In this research, the PV System application is used to perform the engineering design to determine the amount of PV that can be installed based on the load requirements at 23 substations. In general, the steps used in the PV-Syst simulation used in this study are as follows:

- Create a new project based on the location point.
- Input the location based on Table I to obtain the meteo file. These data are environmental data in the form of global horizontal irradiance (GHI), temperature, and others in the PV System application database.
- Determine the orientation of the solar panel to be installed. In this research, it was determined that the plane tilt is 5° and the azimuth is 0°.
- Enter the technical design parameters of the rooftop PV system to be installed. At this stage, the first thing to be done is to determine the capacity based on the installed substation auxiliary load data. The author uses a capacity of 1.5 times the maximum load of each substation. The basis of this determination is to meet the

Table 1. LIST OF SUBSTATION AND COORDINATE LOCATION

No.	Substation	Coordinate Location
1	Maloy	0.9240714292072126, 117.849383714792
2	Sangatta	0.4721112155937056, 117.57055829262899
3	Teluk Pandan	0.16344728965001734, 117.43527484690232
4	Muara Badak	-0.31026437358867215, 117.29168543675256
5	New Samarinda	-0.4068215823989753, 117.1663428716843
6	Sambutan	-0.5251231713622516, 117.21419402530292
7	Kota Bangun	-0.2710961612463912, 116.59555389098061
8	Bukit Biru	-0.4558801771471668, 116.97849439594592
9	Embalut	-0.38186850147653895, 117.05121780582225
10	Tengkawang	-0.5025235583121095, 117.11349086968738
11	Harapan Baru	-0.5473087315642758, 117.10670067459687
12	Bukuan	-0.5832135473056099, 117.1932927205716

13	Karang Joang	-1.1487511554770797, 116.87785841446522
14	Manggar Sari	-1.238087244158529, 116.94927336586046
15	New Balikpapan	-1.2258610566286643, 116.8904381579581
16	Industri	-1.2618428063952936, 116.84131112360255
17	Kariangau	-1.1654650291917648, 116.79208682724385
18	Petung	-1.3408153464332517, 116.67184527421396
19	Longikis	-1.516298671050907, 116.32304734534814
20	Kuaro	-1.803434711228812, 116.09377590011634
21	Grogot	-1.8985684107644853, 116.1660171365407
22	Komam	-1.8274758357930712, 115.86953853464982
23	Tanjung Selor	2.810425134405983, 117.36760801997129

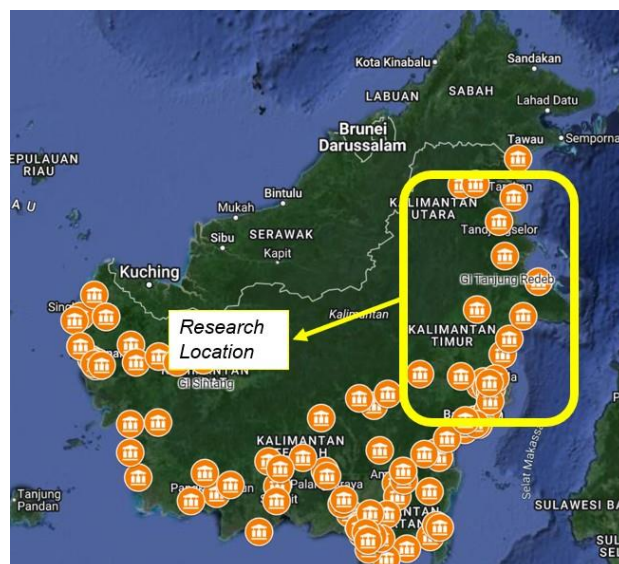


Figure 2. Research Location

load requirements by providing a 50% reserve. The PV system designed in this study is a rooftop PV system using the roof of the substation building (Fig. 3). Once the capacity has been determined, the type of panel and inverter to be used in the study will be determined.

- Determine the economic parameters. The economic parameters that will be included in the PV system application include module price, module support, inverter, wiring, combiner box, monitoring display system, metering system, installation service price, project lifetime, inflation rate, and electricity tariff (IDR 1500/kWh).
- Carry out a techno-economic simulation. This stage is the last stage of the PV System application, where the output results of calculations using the PV System application will be explained in the result section of this paper.

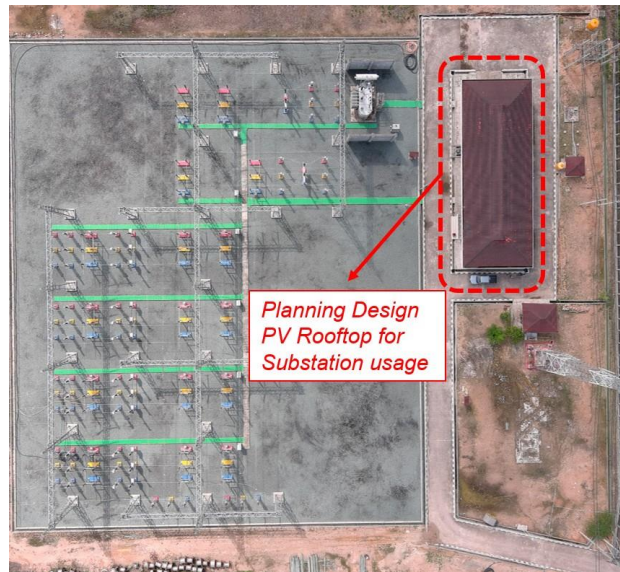


Figure 3. Planning Design PV Rooftop for Substation Usage

D. Saving Cost Analysis

This stage will determine whether or not the installation of a PV rooftop at the substation is feasible based on economic aspects. The economic parameters that will be the basis are the levelized cost of electricity (LCOE), payback period (in units of years), internal rate of return (IRR), and return on investment from the installation of PV rooftops in 23 substations.

3. Results and discussion

According to the research that has been carried out, some points that can be the basis of recommendations for the installation of PV for the needs of auxiliary substations are as follows:

A. A stable substation load profile during the day is suitable for rooftop PV installation.

In terms of operation, the substation is in operation 24 hours a day. The main load supplied by the auxiliary substation is in the form of air conditioning (AC) for temperature maintenance of equipment such as relays and bay control units (BCU), lighting (lighting), and supply of auxiliary motor drives. Substation auxiliary needs vary, but at least in the East Kalimantan region, based on the years 2022–2023, a minimum of 72,000 kilowatt hours (kWh) per year per substation is required. Using the minimum average calculation, from a total of 23 substations, the auxiliary demand at the substation amounted to 1.8 megawatt hours (MWh) per year. In addition, the load profile at the substation is quite high. This indicates that the auxiliary consumption pattern of the substation is fairly constant throughout the day. Based on the sample at the Muara Badak substation, the load factor in December was 0.90. A constant load, especially during the day, can reduce the impact of electrical instability due to the rise and fall of electrical loads.



PVsyst V7.4.0
VCO, Simulation date:
05/04/24 05:08
with v7.4.0

Project: GI Manggar Sari

Variant: GI Manggar Sari

General parameters				
Grid-Connected System		No 3D scene defined, no shadings		
PV Field Orientation		Sheds configuration		Models used
Orientation		No 3D scene defined		Transposition Perez
Fixed plane				Diffuse Perez, Meteonorm
Tilt/Azimuth	5 / 0 °			Circumsolar separate
Horizon		Near Shadings		User's needs
Free Horizon		No Shadings		Unlimited load (grid)

PV Array Characteristics			
PV module		Inverter	
Manufacturer	Jinkosolar	Manufacturer	Huawei Technologies
Model	JKM-610N-78HL4-BDV	Model	SUN2000-SKTL-M1-400V
(Original PVsyst database)		(Original PVsyst database)	
Unit Nom. Power	610 Wp	Unit Nom. Power	5.00 kWac
Number of PV modules	18 units	Number of Inverters	2 units
Nominal (STC)	10.98 kWp	Total power	10.0 kWac
Modules	2 Strings x 9 in series	Operating voltage	140-980 V
At operating cond. (50°C)		Max. power (~50°C)	5.50 kWac
Pmpp	10.16 kWp	Pnom ratio (DC:AC)	1.10
U mpp	380 V	Power sharing within this Inverter	
I mpp	27 A		
Total PV power		Total inverter power	
Nominal (STC)	11 kWp	Total power	10 kWac
Total	18 modules	Max. power	11 kWac
Module area	50.3 m²	Number of Inverters	2 units
		Pnom ratio	1.10

Array losses				
Thermal Loss factor		DC wiring losses		Module Quality Loss
Module temperature according to Irradiance		Global array res.	232 mΩ	Loss Fraction
Uc (const)	20.0 W/m²K	Loss Fraction	1.5 % at STC	-0.8 %
Uv (wind)	0.0 W/m²K/m/s			
Module mismatch losses				
Loss Fraction		2.0 % at MPP		
IAM loss factor				
Incidence effect (IAM): Fresnel, AR coating, n(glass)=1.526, n(AR)=1.290				
0°	30°	50°	60°	70°
1.000	0.999	0.987	0.962	0.892
				0.816
				0.681
				0.440
				0.000

Figure 4. Planning Design PV Rooftop for Substation Usage

B. Results of the Technical Design Analysis

In this study, technical recommendations were obtained for the technical PV rooftop capacity that can be installed in 23 substations. The highest capacity is installed in the Embalut substation. This is because the Embalut substation has the highest load compared to the other substations (40 kWh at peak load). The total rooftop PV capacity required in the 23 substations is 642 kWp. This PV capacity is defined in the general parameters of the PV System program (Fig. 4) and in the design output of the single line diagram output from the PV System program (Fig. 6).

The configuration design required in this study can be drawn in the PV Syst application. For example, based on (Fig. 4), (Fig. 5) and (Fig. 6), the rooftop PV configuration design at the Manggar Sari Substation uses 18 Jinkosolar brand PV panels with a capacity of 610 Wp connected into 2 strings, where each string is assembled in a series of 9 pieces. The two strings are connected to each Huawei inverter, which has a capacity of 5.0 kW. The total area required is 50 m2, with the average substation roof having a minimum area of

300 m2. Based on the design, the total PV DC power is 11.0 kWp, while the total PV AC power is 10.0 kWAC, with a Pnom ratio of 1.098.

Table 2. RESULT OF TECHNICAL ANALYSIS

No.	Substation	Capacity PV (kWp)	Energy (MWh/year)	LCOE IDR/kWh
1	Maloy	21,96	34,7	790,92
2	Sangatta	27,45	42,4	774,95
3	Teluk Pandan	38,40	58,9	762,73
4	Muara Badak	27,45	41,5	790,78
5	New Samarinda	27,45	41,6	790,08
6	Sambutan	10,98	16,6	1006,20
7	Kota Bangun	21,96	33,6	817,81
8	Bukit Biru	21,96	33,3	825,97
9	Embalut	60,40	91,5	767,64
10	Tengkawang	76,90	117,0	734,52
11	Harapan Baru	27,45	41,8	78,52
12	Bukuan	16,47	25,1	879,23
13	Karang Joang	32,90	51,0	748,81
14	Manggar Sari	10,98	17,1	978,82
15	New Balikpapan	32,90	51,2	745,95
16	Industri	27,45	42,6	770,53
17	Kariangau	21,96	34,0	807,89
18	Petung	21,96	34,0	807,42
19	Longikis	21,96	34,0	808,89
20	Kuaro	27,45	42,3	770,08
21	Grogot	21,96	33,8	812,38
22	Komam	21,96	33,9	810,37
23	Tanjung Selor	21,96	34,2	803,21
Total		642,00	986,10	808,29

Table 3. RESULT ECONOMIC ANALYSIS

No.	Substation	Capacity PV (kWp)	Payback Period (years)	IRR	ROI (%)
1	Maloy	21,96	4,7	23,66	215,6
2	Sangatta	27,45	4,7	23,78	218,2
3	Teluk Pandan	38,40	4,6	24,17	223,6
4	Muara Badak	27,45	4,8	23,10	209,2
5	New Samarinda	27,45	4,8	23,10	209,6
6	Sambutan	10,98	6,3	17,71	134,5
7	Kota Bangun	21,96	5,0	22,53	200,6
8	Bukit Biru	21,96	5,0	22,22	196,3
9	Embalut	60,40	4,6	24,19	223,5
10	Tengkawang	76,90	4,4	25,26	238,7
11	Harapan Baru	27,45	4,8	23,32	212,1
12	Bukuan	16,47	5,4	20,92	178,0
13	Karang Joang	32,90	4,6	24,53	229,0
14	Manggar Sari	10,98	6,0	18,47	146,6
15	New Balikpapan	32,90	4,5	24,66	230,7
16	Industri	27,45	4,7	23,97	220,8
17	Kariangau	21,96	4,9	22,94	206,0
18	Petung	21,96	4,9	22,96	206,3
19	Longikis	21,96	4,9	22,90	205,5
20	Kuaro	27,45	4,7	23,69	217,0
21	Grogot	21,96	4,9	22,75	203,6
22	Komam	21,96	4,9	22,83	204,7
23	Tanjung Selor	21,96	4,8	23,13	208,6
Total		642,00	4,90	22,9	206,2



PVsyst V7.4.0
VC0, Simulation date:
05/04/24 05:08
with V7.4.0

Project: GI Manggar Sari

Variant: GI Manggar Sari

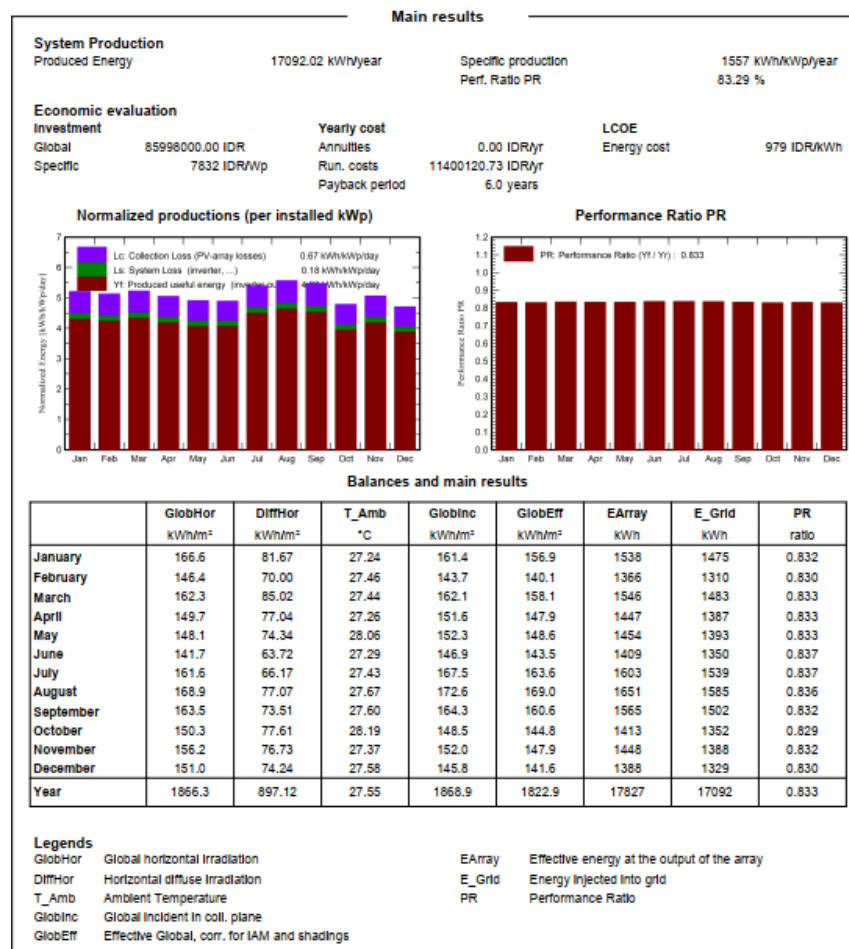


Figure 5. Planning Design PV Rooftop for Substation Usage

The results in Table II show the total PV studied using the PV System application. In addition, it can be seen that the energy that can be generated per year that can be used for the auxiliary needs of the substation is 986.10 MWh per year. The total usage of the North Kalimantan auxiliary substation in 2023, based on primary data measurements, is 3,285 MWh. Based on the table above, it can be concluded that PV rooftop installation can reduce auxiliary substation consumption by 30.01% per year. This means that the use of rooftop PV at the substation can reduce the company's burden by IDR 1.479 billion per year for the substation environment in Kalimantan.

C. On-grid PV system that supports curtailment

In general, the curtailment of rooftop PV can be explained. If the auxiliary load is small while the PV supply is excessive, the excess PV cannot be absorbed by the load, or, in other words, wasted. However, this will not happen because, with the on-grid PV configuration, the excess PV supply is sent to the grid. As it is known, the substation is a load center that is channeled through a 20 kV repeater.

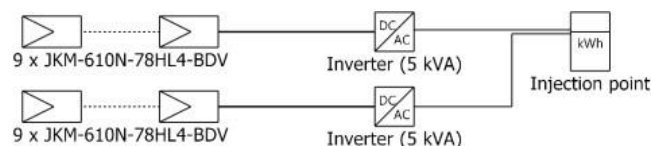


Figure 6. Single Line Diagram Configuration PV in Manggar Sari Substation

D. Economic analysis results: payback period (years), IRR (%), ROI (%)

This study is based on the Levelized Cost of Electricity (LCOE) price of PV technology, which is lower than coal technology [5]. Based on the results of the study, it is evident that the LCOE price of rooftop PV is lower compared to the LCOE price of coal technology.

Based on Table III, the average value of the payback period for PV installation in 23 substations is 4.9 years. This means that with the investment and operating parameters entered in the application, the investment made will be recovered after 4.9 years and will be profitable for the company in the following year. The parameters included in the calculation of the economic analysis are a project life of 25 years, an inflation rate of 2.65%, a discount rate of 5%, an electricity sale price of IDR 1,500/kWh, and the investment and operating values of the PV systems to be installed. The operating value in this case includes the preliminary parameters of the inverter or the lifetime of the inverter. The assumption of 7 years means that the inverter will be replaced after 7 years of use, while the PV panels will not be replaced during the life of the project.

Table III also shows the return-on-investment ROI (%) and the internal rate of return IRR (%). The average value of the IRR is 22.9%, and the ROI is 206%. This value indicates the effectiveness of an investment over the life of the project.

Some points that can be recommended based on this re- search in the future to improve this research are as follows:

- a) *This research recommends a simulation using an ap- plication* : The research—the technical and economic analysis of PV rooftop installation for substation auxiliary needs—can be strengthened with a prototype or real experiment in the field by taking a case in one of the substations. This can strengthen the argumentation of this research.
- b) *This research can be implemented on a larger scale* : In its implementation, this research can be widely implemented on a scale of more than one province, national, and even international scales to support the acceleration of the energy transition. This is because the aid has a typical design.
- c) *Use of primary irradiance data* : The use of primary irradiation data can determine the amount of energy that can be produced by rooftop PV throughout the year. Using primary irradiation measurements rather than the existing database in the PV Syst application can make the study more accurate.
- d) *Optimization study using Battery Energy Storage Sys- tem (BESS)* : the use of BESS can overcome the intermittency effect of rooftop PV, although BESS currently has a high economic value based on the levelized cost of electricity (LCOE) [5].

Finally, the author understands that there are still shortcom- ings in this study. Suggestions and constructive criticism are welcome through the author's email.

5. Conclusion

Based on this research, it can be concluded that :

- Solar energy is the most suitable renewable energy source for use in the substation environment. Solar energy can be harnessed and converted into electrical energy by using rooftop photovoltaic (PV) systems, which can be used to increase the efficiency of the substation's auxiliary kilowatt-hour (kWh) consumption.
- The PV Syst programme is used to analyse the technical and economic aspects of PV rooftop installations in substations.
- Through simulations conducted at 23 substations throughout East Kalimantan, it was determined that a total of approximately 986 MWh per year, or 30.01% of the total 3,285 MWh in 2023, can be saved by reducing the substation auxiliary kilowatt-hour (kWh) consumption.
- After the Break Event Point (BEP) period, the conversion of the average production price of IDR 1,500 Rp/kWh into rupiah results in annual savings of IDR 1.47 billion. The average BEP period is 4.9 years.

References

- [1] N. Reyseliani, A. Hidayatno, and W. W. Purwanto, "Implication of the Paris agreement target on Indonesia electricity sector transition to 2050 using TIMES model," *Energy Policy*, vol. 169, Oct. 2022, doi: 10.1016/j.enpol.2022.113184.
- [2] F. R. Pratikto, P. K. Ariningsih, and C. Rikardo, "Willingness to Pay for Greener Electricity Among Non-Subsidized Residential Consumers in Indonesia: A Discrete Choice Experiment Approach," *Renewable Energy Focus*, vol. 45, pp. 234–241, Jun. 2023, doi: 10.1016/j.ref.2023.05.002.
- [3] D. Setyawati, "Analysis of perceptions towards the rooftop photovoltaic solar system policy in Indonesia," *Energy Policy*, vol. 144, Sep. 2020, doi: 10.1016/j.enpol.2020.111569.
- [4] M. Letebele and J. Van Coller, "Grid independent (renewable) hybrid power sources for the supply of transmission switching substation auxiliaries," in *2021 IEEE PES/IAS PowerAfrica*, PowerAfrica 2021, Institute of Electrical and Electronics Engineers Inc., Aug. 2021. doi: 10.1109/PowerAfrica52236.2021.9543124.
- [5] "Global Levelized Cost of Electricity Benchmarks, 2009 - 2023." Accessed: Jun. 24, 2024. [Online]. Available: <https://about.bnef.com/blog/cost-of-clean-energy-technologies-drop-as-expensive-debt-offset-by-cooling-commodity-prices/>.
- [6] "Photovoltaic Power Potential Indonesia." Accessed: Jun. 24, 2024. [Online]. Available: <https://globalsolaratlas.info/download/indonesia>
- [7] "Mean Wind Speed in Indonesia." Accessed: Jun. 24, 2024. [Online]. Available: <https://globalwindatlas.info/area/Indonesia>
- [8] Dib, M., Nejmi, A. and Ramzi, M., 2020. New auxiliary services system in a transmission substation in the presence of a renewable energy source PV. *Materials today: proceedings*, 27, pp.3151-3156.
- [9] Júnior, W.D.A.S., Vasconcelos, A., Arcanjo, A.C., Costa, T., Nascimento, R., Pereira, A., Jatobá, E., Bione Filho, J., Barreto, E., Dias, R. and Marinho, M., 2023. Characterization of the Operation of a BESS with a Photovoltaic System as a Regular Source for the Auxiliary Systems of a High-Voltage Substation in Brazil. *Energies*, 16(2), pp.1- 25.
- [10] Al-Ashwal, A., 1998. Photovoltaic system for transmission substation application.

- Renewable energy, 14(1-4), pp.157-163.
- [11] Filip, B. and Dragomir, M., 2016, October. Using the photovoltaic renewable sources for high-voltage substation utilities. In 2016 International Conference and Exposition on Electrical and Power Engineering (EPE) (pp. 707-710). IEEE.